


60 THK. MASONRY FACING ON 50 MIN. THK. CEMENT MORTAR (SET IN 1 : 3 CEMENT / SAND) OR 75 THK. CONCRETE APRON, AS SPECIFIED; ALL TO BE OMITTED IF THIS AREA IS SPRAYED CONCRETE

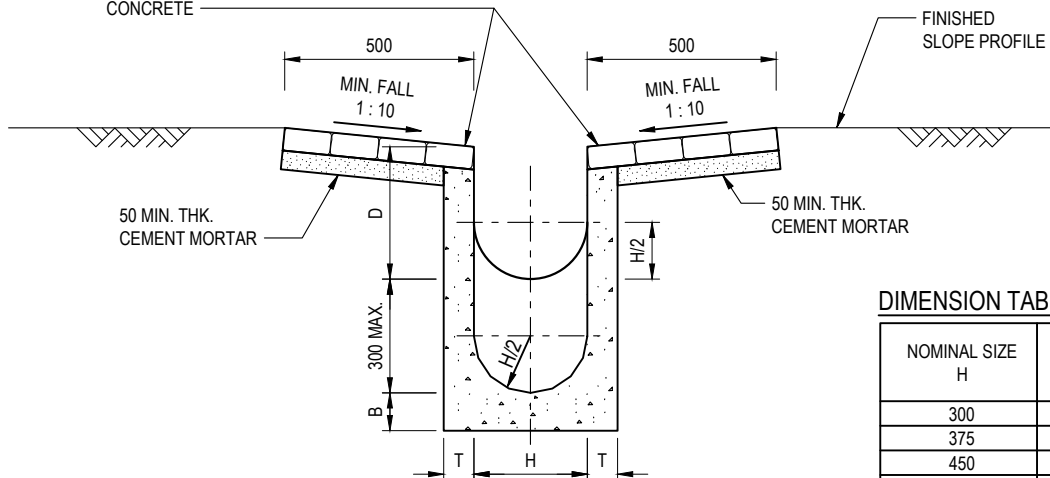

DIMENSION TABLE

NOMINAL SIZE H	T	B	D
300	80	100	350
375	100	150	540
450	100	150	575
525	100	150	615
600	100	150	650
675	125	175	740
750	125	175	775
900	125	175	850

NOTES:

- ALL DIMENSIONS ARE IN MILLIMETRES.
- FOR DIMENSIONS OF CHANNELS SEE TABLE.
- ALL CONCRETE SHALL BE GRADE 20 / 20.
- CONCRETE SURFACE FINISH SHALL BE CLASS U2 OR F2 AS APPROPRIATE.
- EXPANSION JOINTS SHALL BE PROVIDED AT A MAXIMUM SPACING OF 10 METRES WITH DETAILS AS SHOWN ON STD. DRG. NO. C2413.
- 675 - 900 CHANNELS SHALL BE REINFORCED AS SHOWN ON STD. DRG. NO. C2410.

H	BIM OBJECT REVISION.	Original Signed	12.2025
G	GENERAL REVISION.	Original Signed	08.2006
F	NAME OF DEPARTMENT AMENDED.	Original Signed	01.2005
E	NOTE 6 AMENDED.	Original Signed	01.2004
D	GENERAL REVISION.	Original Signed	12.2002
C	MINOR AMENDMENT.	Original Signed	08.2001
B	MINOR AMENDMENT.	Original Signed	3.94
A	MINOR AMENDMENT.	Original Signed	11.92
REF.	REVISION	SIGNATURE	DATE

DETAILS OF STEPPED CHANNEL



CIVIL ENGINEERING AND DEVELOPMENT DEPARTMENT

SCALE 1:20

DRAWING NO.

DATE JAN 1991

C2411H